


MATERIAL LIST

- ① GATE VALVE
- ② WATER METER
- ③ FLANGED COUPLING ADAPTOR
- ④ SILENT CHECK VALVE
- ⑤ TEST PORT WITH VALVE
(FOR 100Ø METERS OR LARGER)
- ⑥ THRUST RINGS

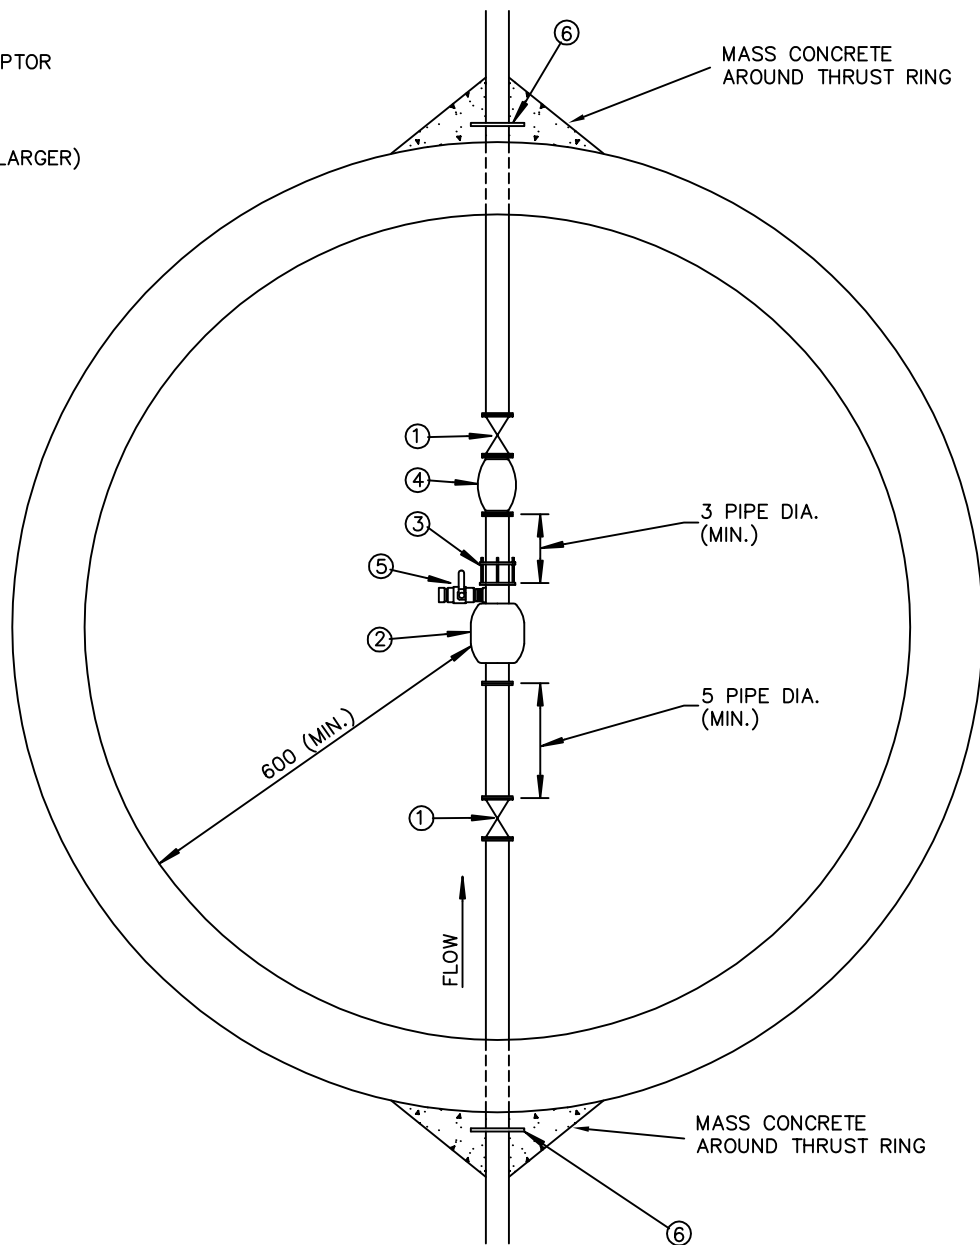

SEE DRAWING W13
FOR METER CHAMBER
DETAILS

NOTES:

- 1. ONLY PRODUCTS APPROVED BY THE TOWN ENGINEER WILL BE ACCEPTED FOR INTALLATION
- 2. METER ASSEMBLY TO BE SUPPORTED BY STEEL PIPE SUPPORTS AS REQUIRED
- 3. THRUST BLOCKING TO BE INSTALLED AS REQUIRED
- 4. 50Ø METER MAY BE INSTALLED IN A CONCRETE SERVICE BOX (AS PER STANDARD DRAWING W12)

DIMENSIONS ARE IN MILLIMETRES UNLESS OTHERWISE NOTED



TOWN OF LADYSMITH
ENGINEERING STANDARD

DOMESTIC WATER METERS
(50Ø - 250Ø) PIPING LAYOUT

DATE: FEB. 1994

APP. BY:

DRAWING No.
W16

REV.
00