


SECTION X-X

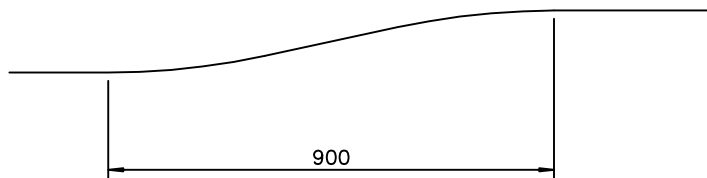

CURB DROP DETAIL

NOTES:

1. MINIMUM CONCRETE SIDEWALK THICKNESS SHALL BE 150mm.
2. FOR CONCRETE DETAILS SEE SECTION 10.
3. REINFORCEMENT: 3M (3/8") BARS IN BOTH DIRECTIONS @ 300mm SPACING.
4. COMMERCIAL AND INDUSTRIAL ACCESS SHALL HAVE THE CURB REINFORCEMENT IN ACCORDANCE WITH STD. DWG. C2.

DIMENSIONS ARE IN MILLIMETRES UNLESS OTHERWISE NOTED



TOWN OF LADYSMITH  
ENGINEERING STANDARD

SIDEWALK & DRIVEWAY CROSSING

DATE: MAY 2002

APP. BY:

DRAWING No.

C5

REV.

01